



Purchasing Department
140 Stonewall Avenue West, Ste 204
Fayetteville, GA 30214
Phone: 770-305-5420
www.fayettecountyga.gov

September 19, 2018

Subject: Invitation to Bid #1553-B: Parks Sports Lighting with Poles - Addendum #1

Gentlemen/Ladies:

Below, please find responses to questions, clarification, or additional information for the above referenced Invitation to Bid. You will need to consider this information when preparing your bid.

- 1. Is the metal pole with concrete base facing the parking lot to be removed with the field lights at McCurry Park Soccer field #1 since that particular pole is tied into the existing electrical panel box?**

Yes, the two lights poles with concrete bases beside McCurry Park Soccer Field #1 and the pole with the concrete base facing the parking lot are to be removed.

- 2. Can we look into the panel box on Kiwanis Field #9 and #11 to see if there is any electrical space left in the panel box?**

There are spaces for two additional breakers left in the panel box. See attached pictures. Exhibits A-E.

Received by _____ Company _____


Note: Please sign and return this addendum with your submitted bid. Any bidder not returning a signed addendum will still be responsible for compliance with any requirements, specifications, or changes contained in the addendum.

So that this project can be completed in a timely manner, the time for submitting questions has expired.

The opening date for this ITB has not changed. **The opening time and date is 3:00pm, Tuesday, September 25, 2018.** Bids must be received by the Purchasing Department at the address above in, Suite 204, at or before the opening date and time.

If you have questions, please contact the purchasing department, at (770) 305-5420, fax (770) 719-5509 or email at PurchasingGroup@fayettecountyga.gov.

Sincerely,

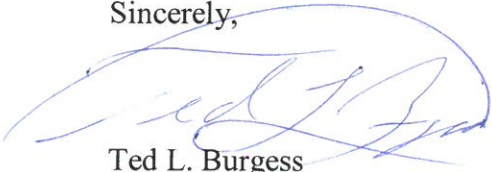A handwritten signature in blue ink, appearing to read "Ted L. Burgess", is written over a large, light blue oval scribble.

Ted L. Burgess
Director of Purchasing

TLB\tc

Attachments



Exhibit A

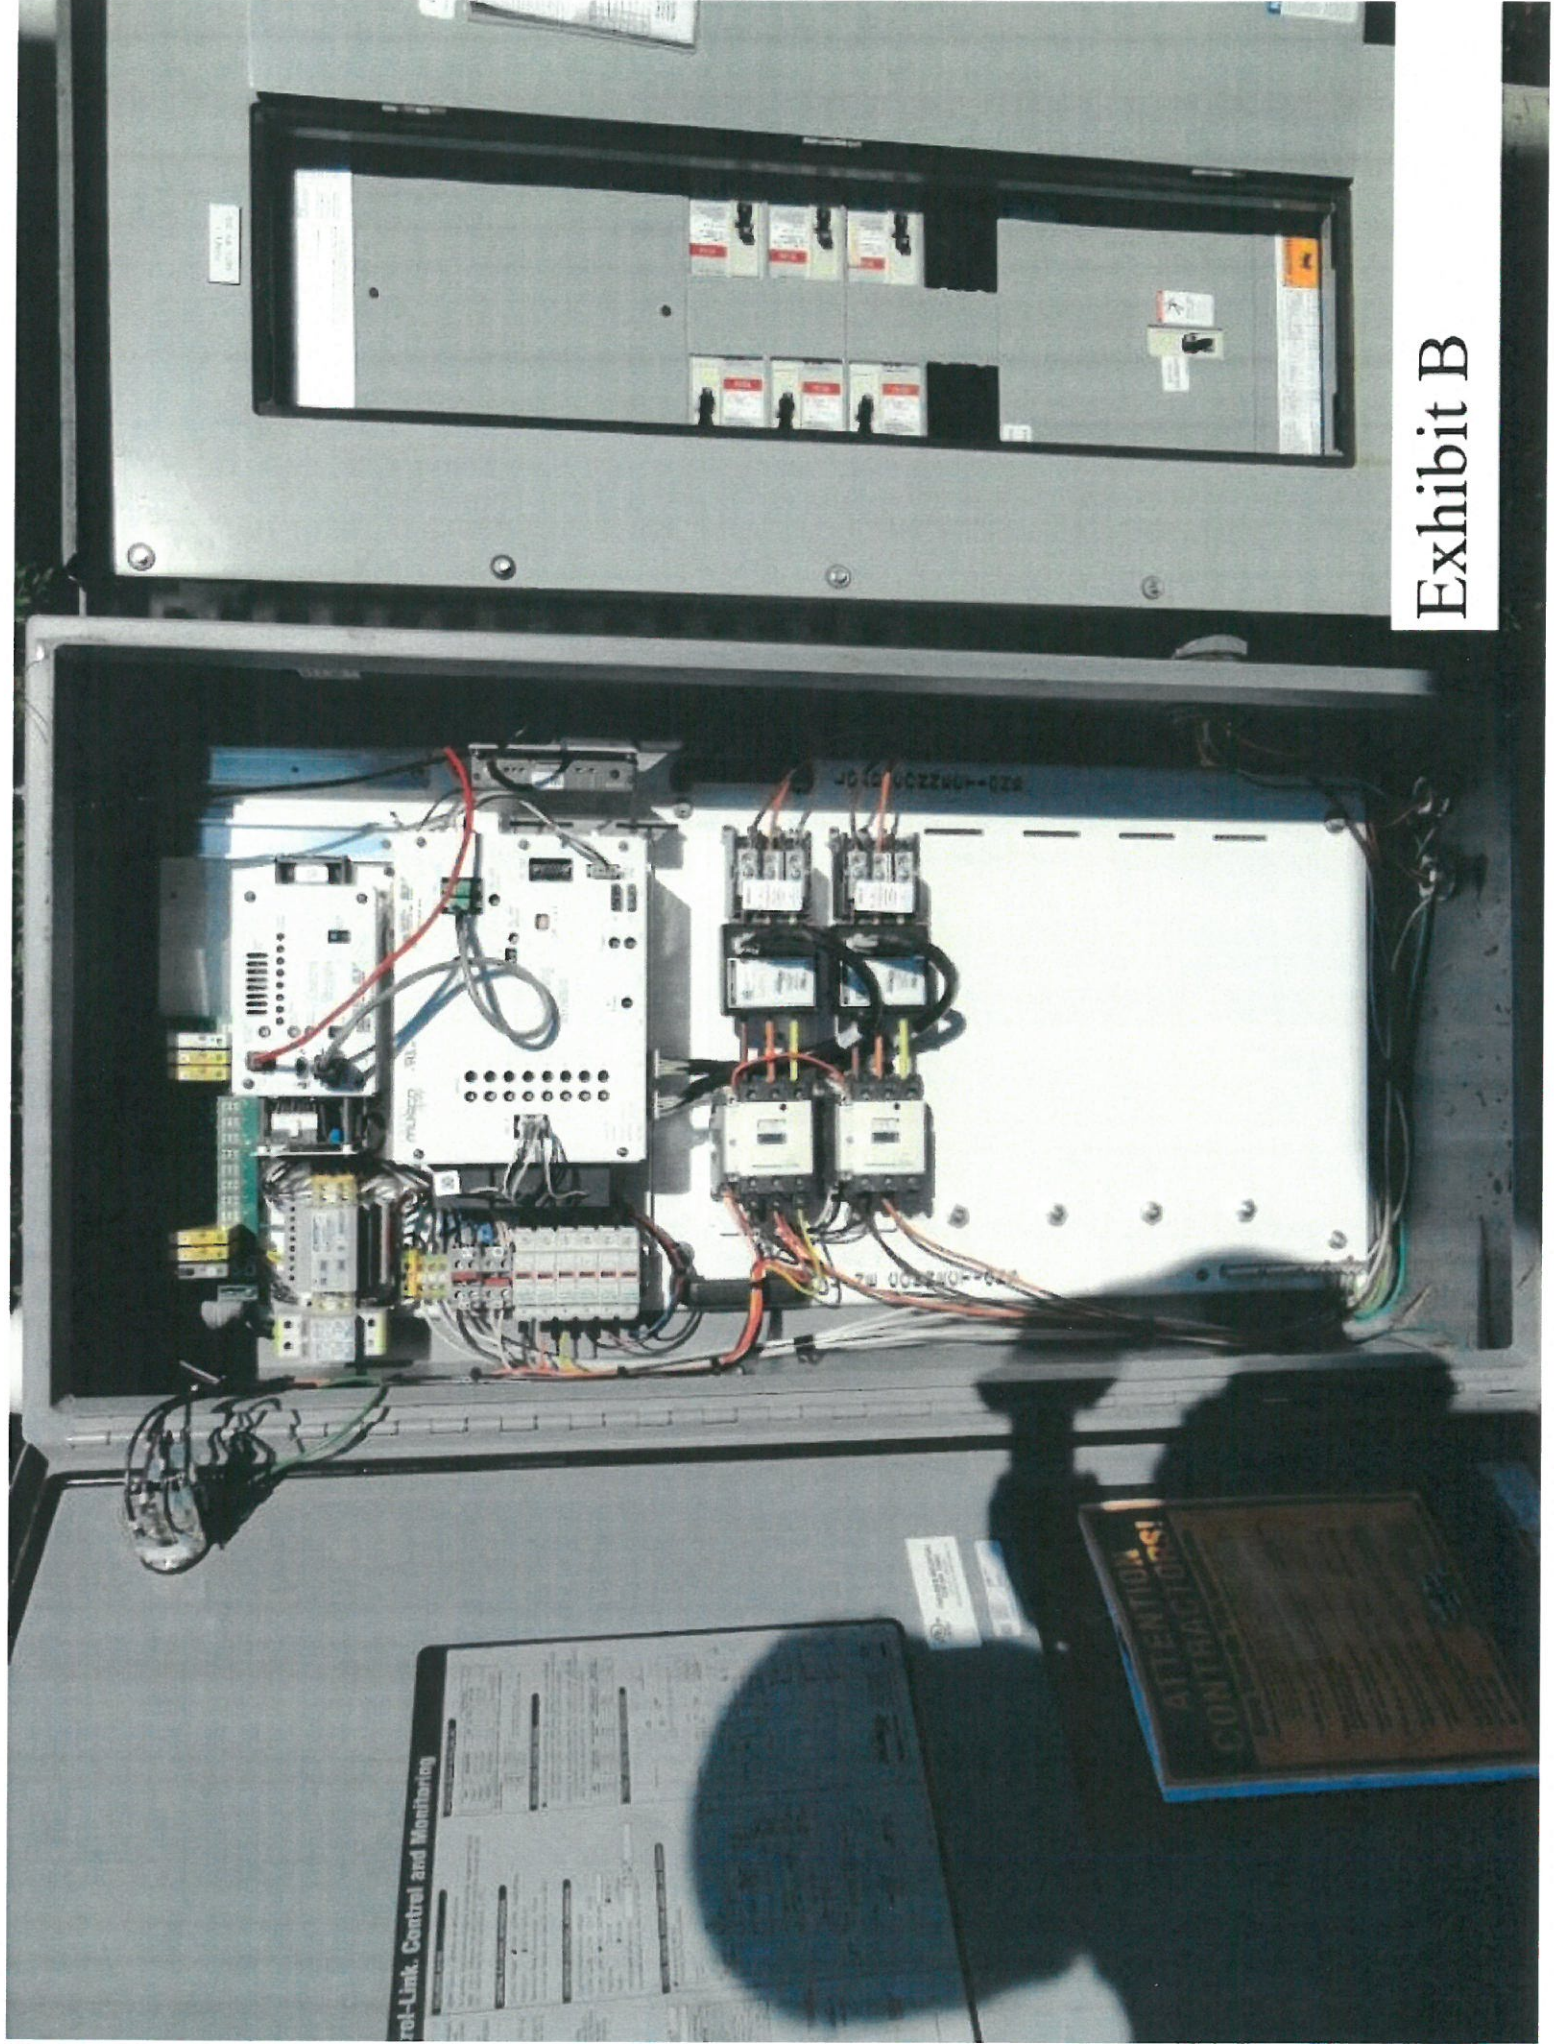


Exhibit B

| Model | 480V + Phase | Phase | Power | Capacity | Weight | Dimensions |
|-------|--------------|-------|-------|----------|--------|------------|
| 1 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 2 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 3 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 4 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 5 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 6 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 7 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 8 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 9 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 10 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 11 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 12 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 13 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 14 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |
| 15 | 3 | 3 | 1000 | 1000 | 1000 | 1000 |

W. King Communications
 470 New Street, C. 200
 New York, NY 10013

Exhibit D

| | | |
|---------------|---------------|---------------|
| <p>FD 304</p> | <p>FD 304</p> | <p>FD 304</p> |
| <p>FD 304</p> | <p>FD 304</p> | <p>FD 304</p> |

MODEL NO. 1000
 1000 1000 1000

SERVICE
 DISCONNECT

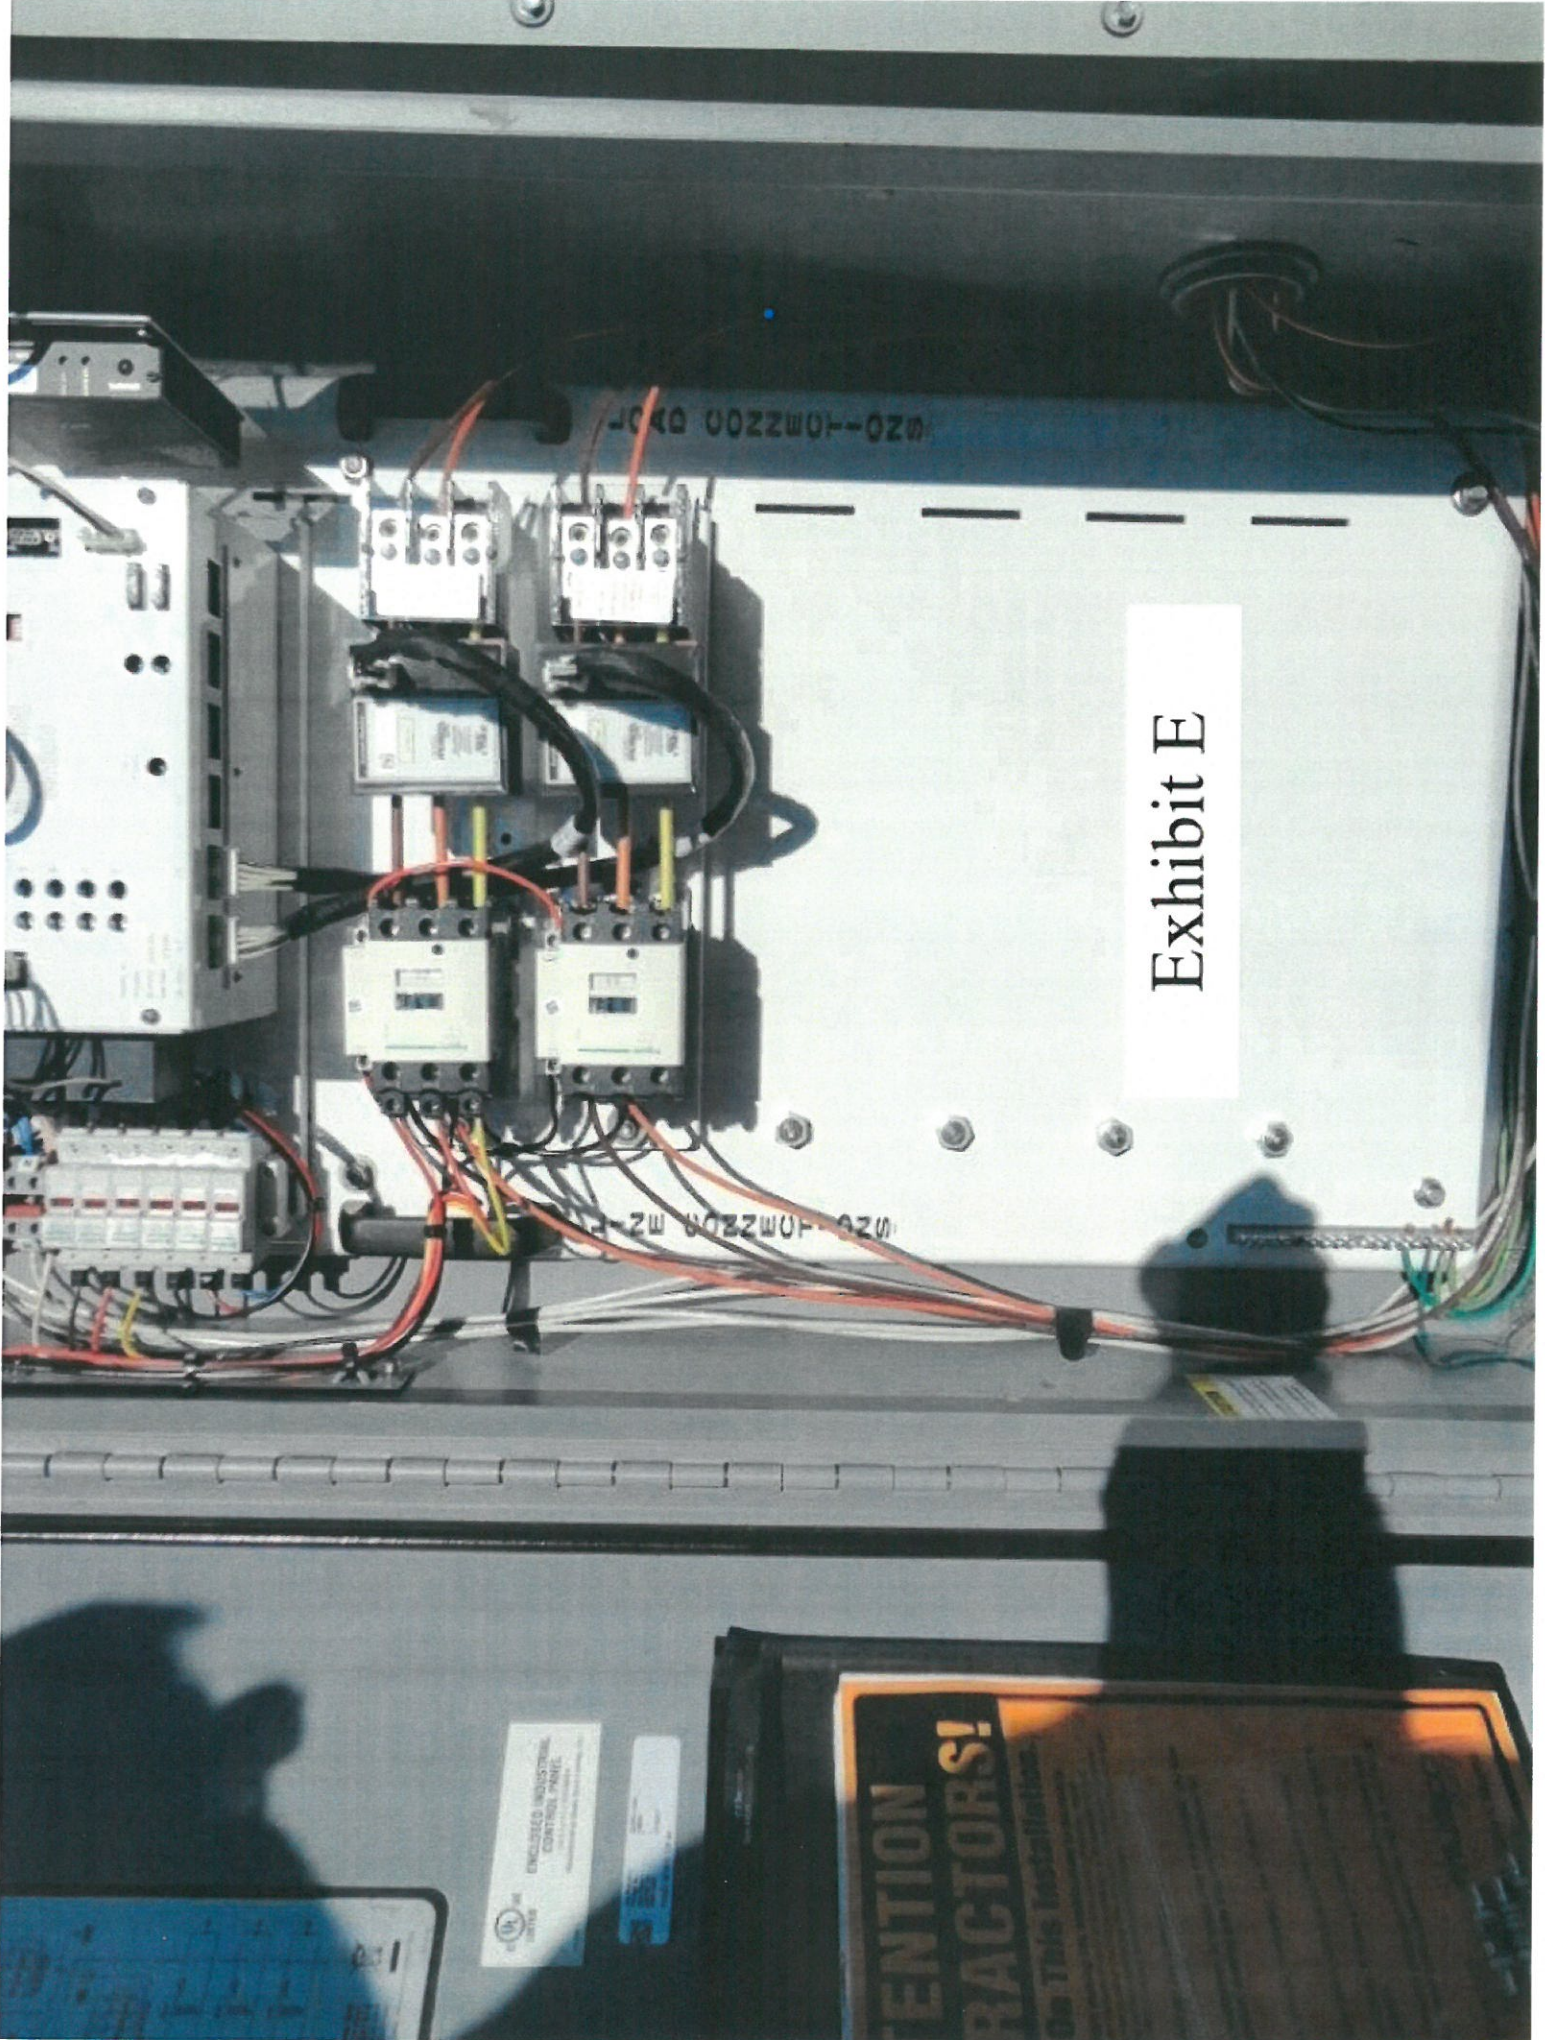


Exhibit E

ENCLOSED INDUSTRIAL CONTROL PANEL

CAUTION REACTORS!