

Annual Inspection Report

Completed on: 2025-03-04

for

Fayette County 911 Center
110 Volunteer Way
Fayetteville, GA 30215

Conducted By:

Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)

Acom Fire Solutions

7521 Veterans Parkway

Columbus, Georgia 31909

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Inspection Summary

This is to certify that our representative has inspected the equipment noted below and that he has left the equipment in operating condition. There is available in our file, a complete record of conditions as found and all repairs made and recommended.

Tag Color

(Green Tag) Sprinkler Operational

(Yellow Tag) Sprinkler Operational with Deficiencies

(Red Tag) Sprinkler Inoperable

5-Year Sprinkler Inspection

Kitchen Suppression Compliant

(Red Tag) Kitchen Suppression Non Compliant

SPRINKLER SUMMARY

SYSTEM	TECHNICIAN	TAG COLOR	QTY INSPECTED	QTY FAILED	DATE INSPECTED
General	Cody Cook		1	0	2025-03-04
General Wet	Cody Cook		1	0	2025-03-04
Wet	Cody Cook	(Green Tag) Sprinkler Operational 	1	0	2025-03-04
	Cody Cook		1	0	2025-03-04
ITV	Cody Cook		1	0	2025-03-04

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Report of Inspection / Test General Questions

OWNER SECTION

Is the building occupied?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Has the occupancy classification and hazard of contents remained the same since the last inspection?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are all fire protection systems in service?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Has the system remained in service without modification since the last inspection?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Was the system free of actuations of devices or alarms since the last inspection?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		

FIRE DEPARTMENT CONNECTION

Is the FDC plainly visible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the FDC easily accessible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is the FDC swivels and couplings not damaged?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the FDC caps and plugs in place?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the FDC gaskets in place and in good condition?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the FDC check valve drip free?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is the clapper and automatic drain valve in place and properly operating?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the FDC identification sign(s) in place?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA

SPRINKLER HEADS

Are there the proper number and type of spare sprinklers?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are visible sprinklers in the proper position: upright, pendent, sidewall?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are visible sprinklers free of corrosion and physical damage?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is there proper clearance below the sprinklers?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are visible sprinklers free of foreign materials including paint?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is there liquid in all visible glass bulb sprinklers?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are there spare sprinklers and a sprinkler wrench?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the information sign attached and legible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are all the sprinklers dated 1920 or later?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Fast response sprinklers 20 or more years old replaced or successfully sample tested within last 10 years?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Standard response sprinklers 50 or more years old replaced or successfully sample tested within last 10 years?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Standard response sprinklers 75 or more years old replaced or successfully sample tested within last 5 years?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Dry-type sprinklers replaced or successfully sample tested within last 10 years?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Have sprinklers subject to harsh environments been replaced or successfully sample tested in the last 5 years?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

PIPES

Is the visible pipe in good condition with no external corrosion?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Does visible pipe have no mechanical damage or leaks?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Does visible pipe have no external loads?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are visible pipe hangers and seismic braces not damaged or loose?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is the pipe through freezers free if any ice blockage?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Has an internal investigation of the pipe (remove a flushing connection and a sprinkler near the end of a branch line) been performed in the last 5 years? (If no conduct investigation)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA

VALVE AREA

Are the control valves (including backflow preventer isolation valves) supervised with seals in correct (open or closed) position?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including backflow preventer isolation valves) supervised with seals locked or is supervision in place?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including backflow preventer isolation valves) supervised with seals accessible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including backflow preventer isolation valves) supervised with seals free from leaks?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including backflow preventer isolation valves) supervised with seals have appropriate wrenches?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including backflow preventer isolation valves) supervised with seals properly identified?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including valves on backflow preventers) with locks or electrical supervision in correct (open or closed) position?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including valves on backflow preventers) with locks or electrical supervision locked or is supervision in place?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including valves on backflow preventers) with locks or electrical supervision accessible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including valves on backflow preventers) with locks or electrical supervision free from any leaks?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including valves on backflow preventers) with locks or electrical supervision have the appropriate wrenches?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including valves on backflow preventers) with locks or electrical supervision properly identified?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are all check valves externally inspected, operating properly, and are in good condition?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the gauges on system in good condition and showing normal water supply pressure?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is the hydraulic name plate (calculated systems) attached securely to the riser and legible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are Pressure reducing valves in open position and not leaking?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Are Pressure reducing valves with downstream pressure per the design?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Are Pressure reducing valves in good condition including no handwheels broken?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
Have the mechanical waterflow alarm devices passed tests by opening inspector's test connection/bypass connection with alarms actuating and flow observed?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Do valve supervisory switches indicate movement?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
The electrical waterflow alarm devices passed test by opening inspector's test connection/bypass connection with alarms actuating and flow observed?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Have post indicating valves been opened until spring or torsion felt in the rod and then closed back 1/4 turn?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
All control valves operated through full range and returned to normal position?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Have pressure reducing valves passed partial flow test?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

BACKFLOW PREVENTERS

Is relief port on RPZ device not discharging?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Have backflow devices passed forward flow test?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
---	---	---	---

ALARMS

Is the alarm valve free from physical damage?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the trim in correct (open or closed) position?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is there no leakage in the retarding chamber or drains?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are alarms and supervisory devices not damaged?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Do low temperature alarms look ok?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		

MAINTENANCE

Perform an obstruction investigation if any of the following were found: defective intake screen on pump supplied from open sources, obstructive material discharged during flow tests, foreign material in dry-type valves, foreign material in water during drain test or plugging of inspector's test connection, plugging of pipe or sprinklers found, failure to flush yard piping or surrounding mains following new installation or repairs, record of broken mains in the vicinity, abnormal frequent false-tripping of dry valves, system has just been returned to service after more than 1 year, there is a reason to think the system contains sodium silicate or its derivatives or highly corrosive fluxes in copper pipe, raw water was pumped into the fire department connection, pinhole leaks	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	If a sprinkler failed a sample test were all the sprinklers represented by that sample replaced?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
If sprinklers have been replaced, were they proper replacements?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Were marine systems normally having fresh water drained and refilled twice if raw water got into the system?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Was heat tape inspected per the manufacturer's instructions? <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	If conditions were found that required flushing, was flushing of the system conducted? <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
Have adjusted, repaired, reconditioned, or replaced components had proper tests/inspections performed? <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Was a drain test conducted after opening any closed valve? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Operating stem of all OS&Y valves lubricated, completely closed and reopened? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Sprinklers and spray nozzles protecting commercial cooking equipment and ventilating systems replaced except for bulb-type which show no signs of grease buildup? <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Report of Inspection / Test for System - Wet Sprinkler

Tag Color

Tag Color

(Green Tag) Sprinkler Operational

MAIN DRAIN FLOW TESTS

System	Initial Static	Residual	Static	Seconds to Return to Initial Static	Flow Observed?	Did waterflow alarm operate?	Are results comparable to previous test?
Wet Sprinkler	82	70	82	4	Yes	Yes	Yes

INSPECTORS TEST CONNECTION

Wet Sprinkler (Wet)

Location	Description	Time to Alarm (seconds)	Reported?	Smooth Orifice	Easily Accessible	Signs?	Pass?
Outdoor restroom back of building	1" test valve	79	Yes	Yes	Yes	Yes	Yes

VALVES

Wet Sprinkler (Wet)

Description	Location	Valve Type	Size	Secured	Open	Easily Accessible	Signs	Exercised	Stems Lubricated	Flow Pass	Tam per Pass
4" Kennedy Butterfly valve	Comm center janitor closet		4 "	Supervision	Yes	Yes	Yes	Yes	Yes	Pass	Pass

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Questions with Photos and Notes

Wet Sprinkler - Tag Color

(Green
Tag)
Sprinkle
r
Operatio
nal

Notes:



Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Deficiencies - General Questions

None

Deficiencies - General Wet System Questions

None

Deficiencies - Wet Sprinkler

None

Deficiencies - Inspectors Test Connection

None

Deficiencies - Valves

None

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County 911 Center
110 Volunteer Way
Fayetteville GA 30215

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Inspector Signature

I state that the information on this form is correct at the time and place of my inspection, and all equipment tested at this time was left in operational condition upon completion of this inspection except as noted.

Inspector Name

Cody Cook
NICET II ITM Fire Alarm
Systems (NFPA 72)
ACE II ITM Water-Based
Systems (NFPA 25)
Portable Fire
Extinguishers (NFPA 10)
Pre-Engineered Kitchen
Suppression Systems
(NFPA 17A & 96)
Emergency Lights / Exit
Signs
Backflow Prevention
(NFPA 13 & 25)

Signature

A handwritten signature in black ink, appearing to read 'Cody Cook', is written across the signature field.

Date Completed

2025-03-04

Annual Inspection Report

Completed on: 2025-03-04

for

Fayette County Library
140 Stonewall Ave W
Fayetteville, GA 30214-1520

Conducted By:

Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)

Acom Fire Solutions

7521 Veterans Parkway

Columbus, Georgia 31909

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Inspection Summary

This is to certify that our representative has inspected the equipment noted below and that he has left the equipment in operating condition. There is available in our file, a complete record of conditions as found and all repairs made and recommended.

Tag Color

(Green Tag) Sprinkler Operational

(Yellow Tag) Sprinkler Operational with Deficiencies

(Red Tag) Sprinkler Inoperable

5-Year Sprinkler Inspection

Kitchen Suppression Compliant

(Red Tag) Kitchen Suppression Non Compliant

SPRINKLER SUMMARY

SYSTEM	TECHNICIAN	TAG COLOR	QTY INSPECTED	QTY FAILED	DATE INSPECTED
General	Cody Cook		1	0	2025-03-04
General Wet	Cody Cook		1	0	2025-03-04
Wet	Cody Cook	(Green Tag) Sprinkler Operational 	1	0	2025-03-04
Butterfly	Cody Cook		1	0	2025-03-04
ITV	Cody Cook		1	0	2025-03-04

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook
NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Report of Inspection / Test General Questions

OWNER SECTION

Is the building occupied?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Has the occupancy classification and hazard of contents remained the same since the last inspection?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are all fire protection systems in service?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Has the system remained in service without modification since the last inspection?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Was the system free of actuations of devices or alarms since the last inspection?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		

FIRE DEPARTMENT CONNECTION

Is the FDC plainly visible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the FDC easily accessible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is the FDC swivels and couplings not damaged?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the FDC caps and plugs in place?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the FDC gaskets in place and in good condition?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the FDC check valve drip free?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is the clapper and automatic drain valve in place and properly operating?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the FDC identification sign(s) in place?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA

SPRINKLER HEADS

Are there the proper number and type of spare sprinklers?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are visible sprinklers in the proper position: upright, pendent, sidewall?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are visible sprinklers free of corrosion and physical damage?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is there proper clearance below the sprinklers?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are visible sprinklers free of foreign materials including paint?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is there liquid in all visible glass bulb sprinklers?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are there spare sprinklers and a sprinkler wrench?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the information sign attached and legible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are all the sprinklers dated 1920 or later?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Fast response sprinklers 20 or more years old replaced or successfully sample tested within last 10 years?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook
NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Standard response sprinklers 50 or more years old replaced or successfully sample tested within last 10 years?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Standard response sprinklers 75 or more years old replaced or successfully sample tested within last 5 years?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Dry-type sprinklers replaced or successfully sample tested within last 10 years?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Have sprinklers subject to harsh environments been replaced or successfully sample tested in the last 5 years?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

PIPES

Is the visible pipe in good condition with no external corrosion?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Does visible pipe have no mechanical damage or leaks?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Does visible pipe have no external loads?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are visible pipe hangers and seismic braces not damaged or loose?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is the pipe through freezers free if any ice blockage?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Has an internal investigation of the pipe (remove a flushing connection and a sprinkler near the end of a branch line) been performed in the last 5 years? (If no conduct investigation)	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA

VALVE AREA

Are the control valves (including backflow preventer isolation valves) supervised with seals in correct (open or closed) position?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including backflow preventer isolation valves) supervised with seals locked or is supervision in place?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including backflow preventer isolation valves) supervised with seals accessible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including backflow preventer isolation valves) supervised with seals free from leaks?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including backflow preventer isolation valves) supervised with seals have appropriate wrenches?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including backflow preventer isolation valves) supervised with seals properly identified?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including valves on backflow preventers) with locks or electrical supervision in correct (open or closed) position?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including valves on backflow preventers) with locks or electrical supervision locked or is supervision in place?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including valves on backflow preventers) with locks or electrical supervision accessible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including valves on backflow preventers) with locks or electrical supervision free from any leaks?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are the control valves (including valves on backflow preventers) with locks or electrical supervision have the appropriate wrenches?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the control valves (including valves on backflow preventers) with locks or electrical supervision properly identified?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Are all check valves externally inspected, operating properly, and are in good condition?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are the gauges on system in good condition and showing normal water supply pressure?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is the hydraulic name plate (calculated systems) attached securely to the riser and legible?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are Pressure reducing valves in open position and not leaking?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Are Pressure reducing valves with downstream pressure per the design?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Are Pressure reducing valves in good condition including no handwheels broken?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
Have the mechanical waterflow alarm devices passed tests by opening inspector's test connection/bypass connection with alarms actuating and flow observed?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Do valve supervisory switches indicate movement?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
The electrical waterflow alarm devices passed test by opening inspector's test connection/bypass connection with alarms actuating and flow observed?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Have post indicating valves been opened until spring or torsion felt in the rod and then closed back 1/4 turn?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
All control valves operated through full range and returned to normal position?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Have pressure reducing valves passed partial flow test?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

BACKFLOW PREVENTERS

Is relief port on RPZ device not discharging?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Have backflow devices passed forward flow test?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
---	---	---	---

ALARMS

Is the alarm valve free from physical damage?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Is the trim in correct (open or closed) position?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Is there no leakage in the retarding chamber or drains?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Are alarms and supervisory devices not damaged?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Do low temperature alarms look ok?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		

MAINTENANCE

Perform an obstruction investigation if any of the following were found: defective intake screen on pump supplied from open sources, obstructive material discharged during flow tests, foreign material in dry-type valves, foreign material in water during drain test or plugging of inspector's test connection, plugging of pipe or sprinklers found, failure to flush yard piping or surrounding mains following new installation or repairs, record of broken mains in the vicinity, abnormal frequent false-tripping of dry valves, system has just been returned to service after more than 1 year, there is a reason to think the system contains sodium silicate or its derivatives or highly corrosive fluxes in copper pipe, raw water was pumped into the fire department connection, pinhole leaks	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	If a sprinkler failed a sample test were all the sprinklers represented by that sample replaced?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
If sprinklers have been replaced, were they proper replacements?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Were marine systems normally having fresh water drained and refilled twice if raw water got into the system?	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
 140 Stonewall Ave W
 Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook
 NICET II ITM Fire Alarm Systems (NFPA 72)
 ACE II ITM Water-Based Systems (NFPA 25)
 Portable Fire Extinguishers (NFPA 10)
 Pre-Engineered Kitchen Suppression Systems
 (NFPA 17A & 96)
 Emergency Lights / Exit Signs
 Backflow Prevention (NFPA 13 & 25)



Was heat tape inspected per the manufacturer's instructions? <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	If conditions were found that required flushing, was flushing of the system conducted? <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
Have adjusted, repaired, reconditioned, or replaced components had proper tests/inspections performed? <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Was a drain test conducted after opening any closed valve? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA
Operating stem of all OS&Y valves lubricated, completely closed and reopened? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA	Sprinklers and spray nozzles protecting commercial cooking equipment and ventilating systems replaced except for bulb-type which show no signs of grease buildup? <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Report of Inspection / Test for System - Wet Sprinkler

Tag Color

Tag Color

(Green Tag) Sprinkler Operational

MAIN DRAIN FLOW TESTS

System	Initial Static	Residual	Static	Seconds to Return to Initial Static	Flow Observed?	Did waterflow alarm operate?	Are results comparable to previous test?
Wet Sprinkler	60	45	60	4	Yes	Yes	Yes

INSPECTORS TEST CONNECTION

Wet Sprinkler (Wet)

Location	Description	Time to Alarm (seconds)	Reported?	Smooth Orifice	Easily Accessible	Signs?	Pass?
Upstairs mechanical	ITV	50	Yes	Yes	Yes	Yes	Yes

VALVES

Wet Sprinkler (Wet)

Description	Location	Valve Type	Size	Secured	Open	Easily Accessible	Signs	Exercised	Stems Lubricated	Flow Pass	Tam per Pass
4" Butterfly Nibco	Electrical Room in Office Back Hallway	Butterfly	4 "	Supervision	Yes	Yes	Yes	Yes	Yes	Pass	Pass

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)




Questions with Photos and Notes

Wet Sprinkler - Tag Color

(Green Tag)
Sprinkler
Operational

Notes:

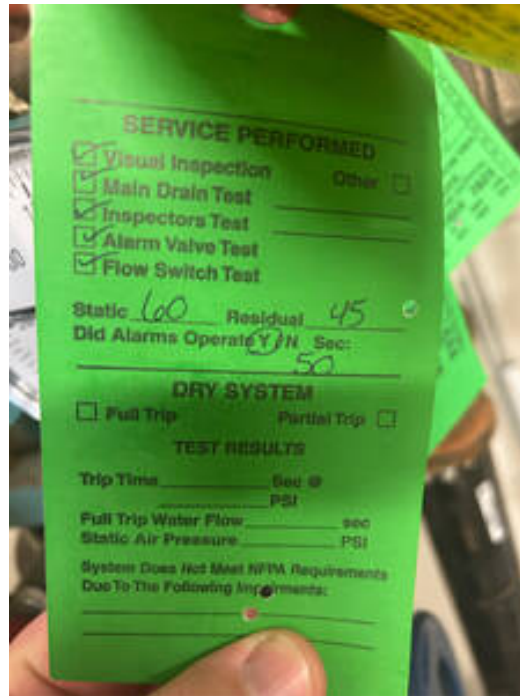

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems (NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)

ACE II ITM Water-Based Systems (NFPA 25)

Portable Fire Extinguishers (NFPA 10)

Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)

Emergency Lights / Exit Signs

Backflow Prevention (NFPA 13 & 25)



Deficiencies - General Questions

None

Deficiencies - General Wet System Questions

None

Deficiencies - Wet Sprinkler

None

Deficiencies - FDC

None

Deficiencies - Inspectors Test Connection

None

Deficiencies - Valves

None

Report of Inspection / Test

Annual NFPA 25

2025-03-04

Property

Fayette County Library
140 Stonewall Ave W
Fayetteville GA 30214-1520

Print Date: 2025-03-04

Conducted by: Cody Cook

NICET II ITM Fire Alarm Systems (NFPA 72)
ACE II ITM Water-Based Systems (NFPA 25)
Portable Fire Extinguishers (NFPA 10)
Pre-Engineered Kitchen Suppression Systems
(NFPA 17A & 96)
Emergency Lights / Exit Signs
Backflow Prevention (NFPA 13 & 25)



Inspector Signature

I state that the information on this form is correct at the time and place of my inspection, and all equipment tested at this time was left in operational condition upon completion of this inspection except as noted.

Inspector Name

Cody Cook
NICET II ITM Fire Alarm
Systems (NFPA 72)
ACE II ITM Water-Based
Systems (NFPA 25)
Portable Fire
Extinguishers (NFPA 10)
Pre-Engineered Kitchen
Suppression Systems
(NFPA 17A & 96)
Emergency Lights / Exit
Signs
Backflow Prevention
(NFPA 13 & 25)

Signature

A handwritten signature in black ink, appearing to read 'Cody Cook', is written across the signature field.

Date Completed

2025-03-04