


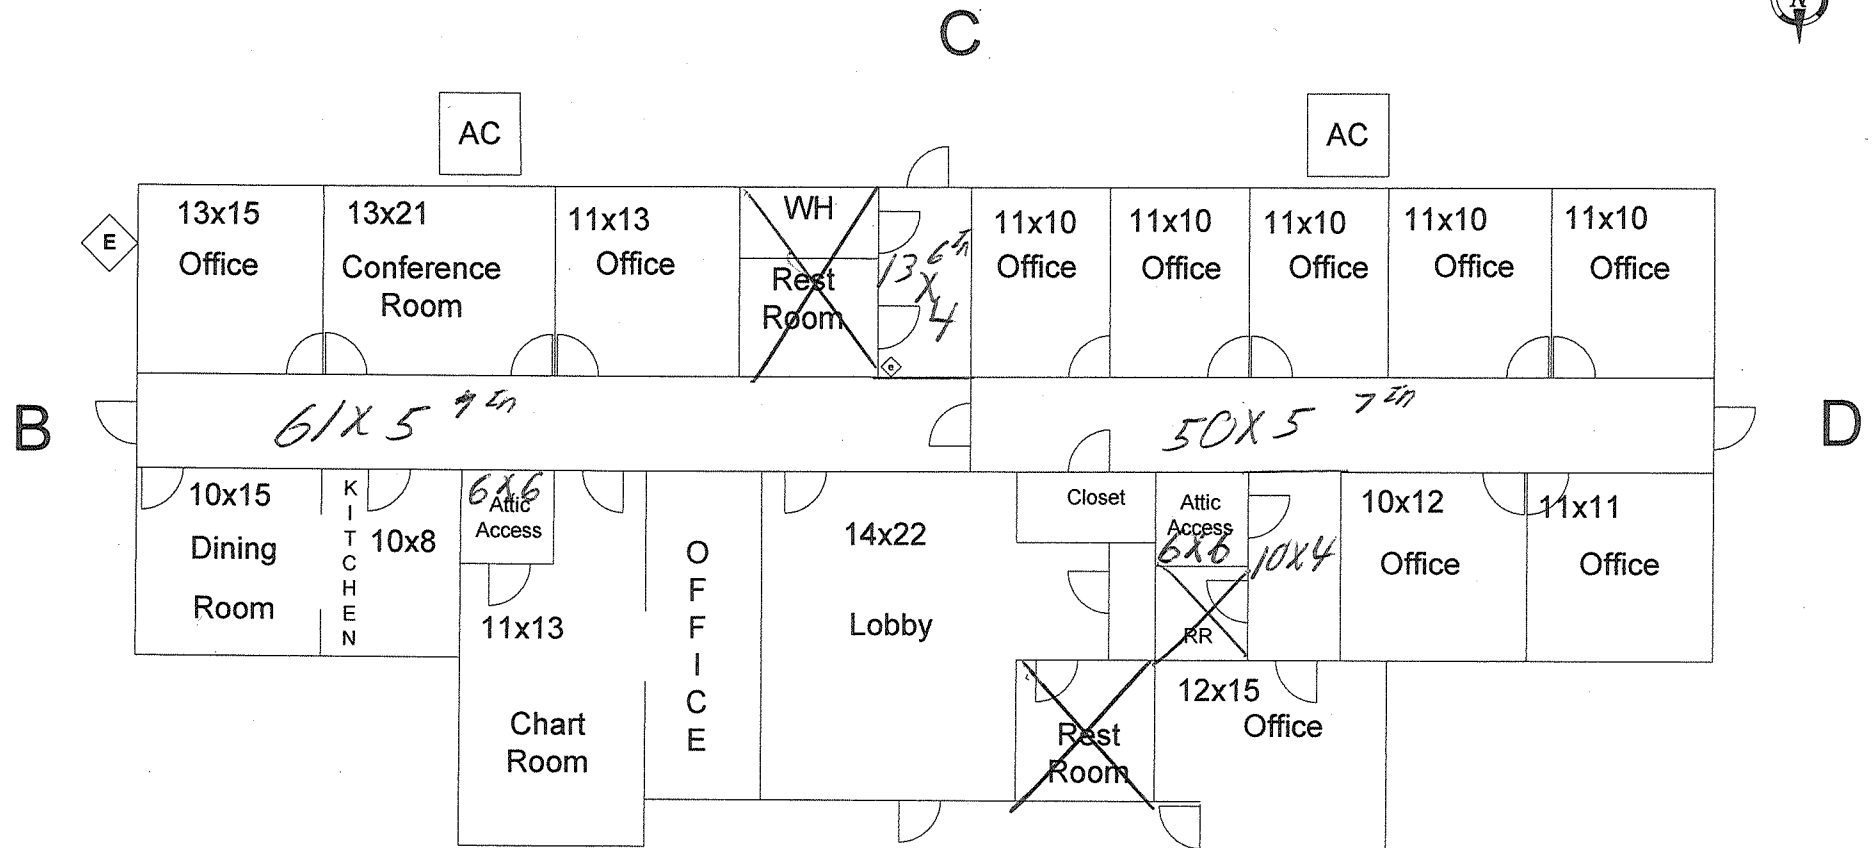

Hydrant is 300 feet north
of driveway on Bradley
Drive

FCP	Fire Alarm Control Panel	2-Way FDC	Diamond	Automatic Sprinkler - Fully Sprinklered	Emergency Light
Knock Box/Keys	Single Door	Gas Line/ Meter	Non - Sprinklered	Riser Valve	
OS & Y Valve	Hydrant	electrical panel	Automatic Sprinkler - Partially Sprinklered	Fire Door	
Radioactive	BioHazard	Hazards	Doors	Overhead Door	Fuel Pump
	Scuttle Hole	2 Lane Road	Dimension Line	LP Tank	
	Attic Access				

NS	
715 Bradley Drive	
Drawing by: Lt. Hartley	03/07/24
Reviewed: Lt. Hartley	SCALE: None