



The Fayette County Water System is pleased to report that your drinking water **SURPASSES** Federal and State water quality requirements.

This Consumer Confidence Report contains important information about the quality of your drinking water as required by the EPA Safe Drinking Water Act.

Fayette County Water System

245 McDonough Road
Fayetteville, GA 30214

Office Hours:
Monday - Friday
8am - 5pm

Water Bill Questions?
(770) 461-1146
water@fayettecountyga.gov

**24/7 Emergency OR
Report a Broken Water Line:**
(770) 461-1146



Dear Valued Water Customer,

As part of our ongoing commitment to transparency and providing you with the highest quality water possible, we are pleased to present our 2023 Water Quality Report. Fayette County Water System staff is committed to delivering the highest quality drinking water, and follow all state and federal guidelines for safe drinking water. We remain vigilant in meeting the challenges of source water protection, water conservation, and community education while continuing to provide safe drinking water to everyone in the community.

We encourage you to take the time to review this report carefully. It's essential to us that you have a clear understanding of the quality of the water we provide, and we're always available to address any questions or concerns you may have.

For more information about this report, please contact our Laboratory and Compliance Specialist at (770)461-1146. Our staff is available to answer questions and provide more information if needed. Thank you for your continued trust in Fayette County Water System.

Vanessa Tigert, Director




2023

ANNUAL WATER QUALITY REPORT


FAYETTE COUNTY PWSID: 1130001
TOWN OF BROOKS PWSID: 1130000

COMMUNITY PARTICIPATION **We Want to Hear from You!**

Your concerns, questions and suggestions are all welcome. Simply use this QR Code to email, call us, and to participate in the next Water Committee public meeting or Water Guardians lake cleanup.

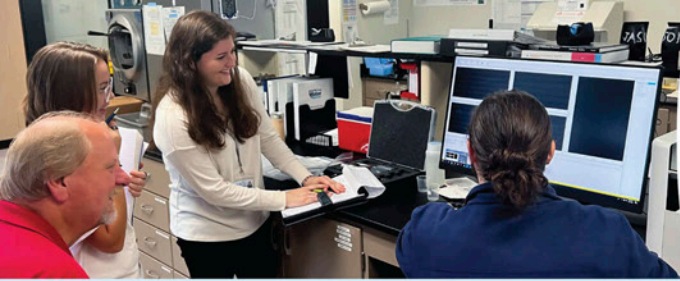

Water Treatment Process

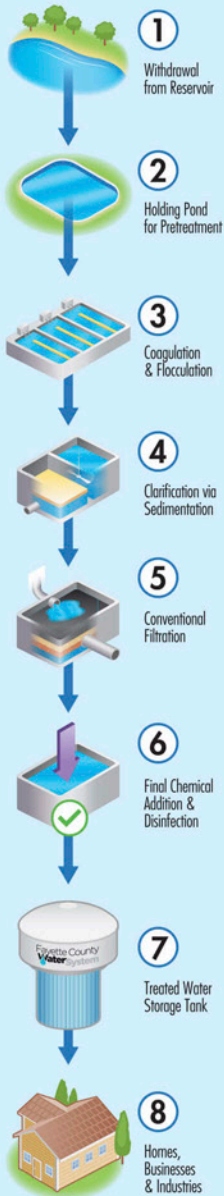

The Fayette County Water System has two water treatment plants that treat surface water to deliver clean, safe drinking water. Both plants pump raw water into their respective raw water holding pond for pretreatment. An oxidizing agent is added to reduce levels of iron, manganese, and some organic material. Alum and lime are added as the water goes into sedimentation basins. Alum and lime cause fine particles such as sediment and organic materials to bond together, forming heavier clumps that settle to the bottom of the basin.

Cleaner, clearer water is skimmed off the top of the basin and is pumped to a dual media filtration system to remove any remaining fine contaminants. After the filtration process, chlorine is added to inactivate pathogens and biological contaminants. The pH of the water is adjusted through lime addition, and added phosphate makes the water less corrosive to pipes. Fluoride is added to prevent dental cavities. Treated drinking water is then pumped from the plants into the distribution system.

Where Does My Water Come From?

Our FCWS Source Water Assessment Plan lists and locates sources of potential contaminants in the four water-supply watersheds. Potential contaminant source locations and developed areas determine the susceptibility rating for each watershed.

Watershed Susceptibility Rating






Flat Creek	Medium - High
Flint River	High
Horton Creek	Low
Line Creek	Low - Medium


In 2023, Fayette County Water System produced 3,538,094,592 gallons of drinking water from Lake Kedron, Lake Peachtree, Lake Horton, and Lake McIntosh. Water from the Flint River is pumped to Lake Horton when needed.

Supplier	Gallons	Percent
City of Atlanta	900,592	<1%
Water Plants (2)	3,537,194,000	>99%
Total	3,538,094,592	100%

 Fayette County Reservoirs

Protected Watersheds

-  Flint River Watershed
-  Lake Horton Watershed
-  Lake Kedron/Peachtree Watershed
-  Lake McIntosh/Line Creek Watershed
-  Whitewater Creek Watershed

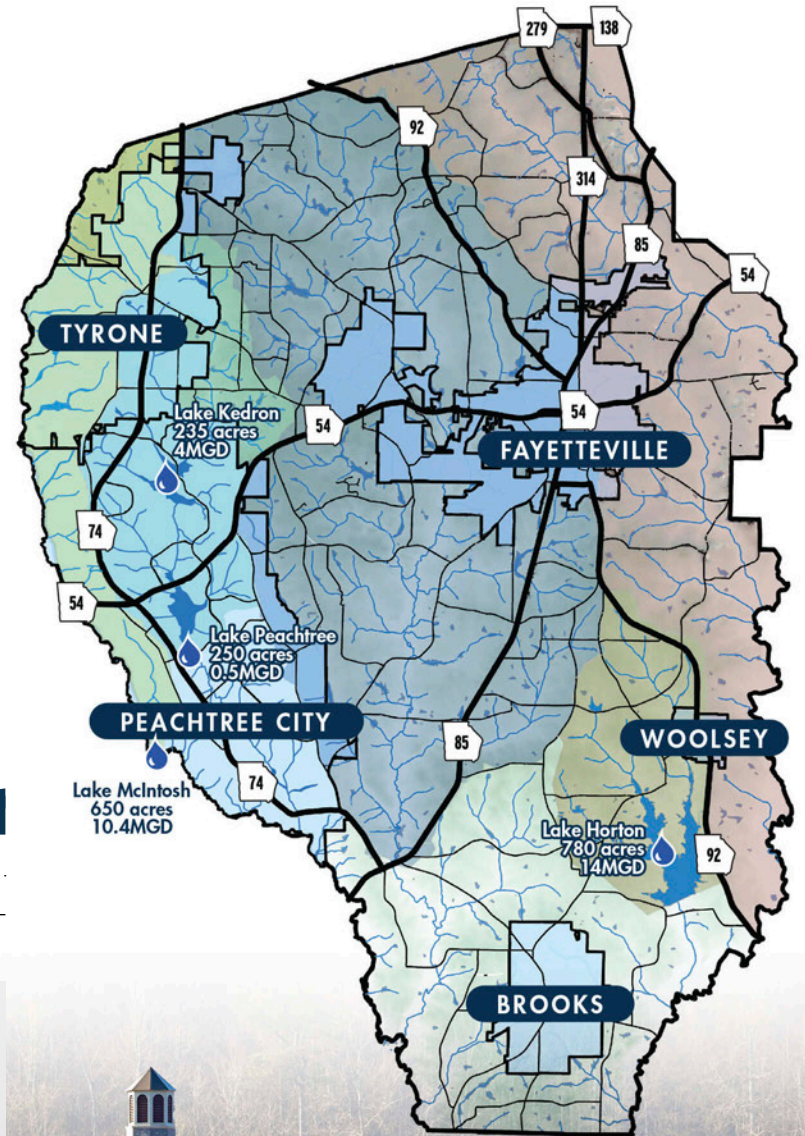

Fayette County Water System 2023 Consumer Confidence Report



How to Read the Table

To understand the tables, compare the value in the **Amount Detected** column against the value in the **MCL** column for that substance. If the **Amount Detected** value is smaller than the MCL value, your water meets the health and safety standards set for the substance. Confirm that there are no violations of state and/or federal standards in the **Violation** column. If there was a violation, you would see a detailed description of the violation in this report. An **ND** or less-than symbol (<) indicates that the substance was not detected, meaning the value is below the detectable limits of the testing method for the substance. The **Range** column displays the lowest and highest values detected for the substance. An **NA** in this column means that only a single sample was taken to test for the substance. The **Typical Source** column gives information on where the substance originated.

Test Results

Only the substances detected in our water are shown in the tables. Remember that detecting a substance does not mean the water is unsafe to drink; our goal is to keep all detects below their respective maximum allowed levels.



Regulated Substances

Substance	Unit of Measure	Year Sampled	Maximum Level (MCL)	Ideal Goal (MCLG)	Amount Detected	Range	Violation	Typical Sources
Fluoride	ppm	2023	4	4	0.60	0.54 - 0.60	No	Water additive that promotes strong teeth
Nitrates	ppm	2023	10	10	ND	ND	No	Runoff from fertilizer use; leaching from septic tanks; sewage; erosion of natural deposits
Total Organic Carbon (TOC)	Removal Ratio ⁽¹⁾	2023	TT ≥ 1	NA	1.13	0.89 - 1.43	No	Decay of organic matter in the water withdrawn from water sources such as lakes and streams
Chlorite	ppm	2023	1	0.8	0.52	0.13 - 0.52	No	By-product of drinking water chlorination
Chlorine, free	ppm	2023	MRDL = 4	MRDLG = 4	1.55	0.20 - 2.40	No	Drinking water disinfectant
Chlorine Dioxide	ppb	2023	MRDL = 800	MRDLG = 800	120	0 - 480	No	Drinking water disinfectant
Turbidity	NTU ²	2023	TT = 1 NTU	NA	0.15	0 - 0.15	No	Soil runoff
Turbidity	% of samples < 0.3 NTU ⁽²⁾	2023	TT = < 0.3 NTU in 95% of the time	NA	100	NA	No	Soil runoff
Total Coliforms	% Positive Samples	2023	5% of monthly samples positive	0	1.2	0 - 1.2	No	Naturally present in the environment.

¹ TOC compliance is a calculated removal ratio of 1 (actual removal is equal to or greater than the required removal) and is reported for compliance as a running annual average, computed quarterly. For our source water, a 35% removal is required.

² Turbidity is a measure of the cloudiness of the water. It is monitored because it is a good indicator of the effectiveness of the filtration system.

Tap Water Samples Collected for Disinfection By-Products Analyses from Sample Sites throughout the Community⁽³⁾

Substance	Unit of Measure	Year Sampled	FAYETTE COUNTY WATER SYSTEM				TOWN OF BROOKS		Violation	Typical Source
			MCL	MCLG	Amount Detected	Range	Amount Detected	Range		
Total Trihalomethanes (TTHMs)	ppb	2023	80	NA	46	21.2 - 63	60	58.9 - 116.9	No	By-product of drinking water chlorination
Total Haloacetic Acids (THAAs)	ppb	2023	60	NA	32	17.5 - 43.8	28	28 - 45.3	No	By-product of drinking water chlorination

³ Some people who drink water containing trihalomethanes in excess of the MCL over many years may experience problems with their liver, kidneys, or central nervous systems and may have increased risk of developing cancer.

Tap Water Samples Collected for Lead and Copper Analyses from Sample Sites throughout the Community⁽⁴⁾

Substance	Unit of Measure	Year Sampled	AL	MCLG	FAYETTE COUNTY WATER SYSTEM		TOWN OF BROOKS		Violation	Typical Source
					Amount Detected (90th %ile)	Site Above AL/ Total Sites	Amount Detected (90th %ile)	Site Above AL/ Total Sites		
Copper (ppm)	ppm	2023	1.3	1.3	0.14	0/30	0.03	0/10	No	Corrosion of household plumbing systems; erosion of natural deposits
Lead (ppb)	ppb	2023	15	0	2.2	0/30	2.4	0/10	No	Corrosion of household plumbing systems; erosion of natural deposits

⁴ Water from the treatment plants does not contain high levels of lead or copper; therefore, water is tested at customer taps. Fayette County Water System and the Town of Brooks qualify for reduced monitoring due to low detection levels of lead and copper.

Unregulated Contaminants Monitoring Rule - Part 5 (UCMR5)⁽⁵⁾

Substance	Unit of Measure	Year Sampled	Amount Detected	Range	Typical Sources
Perfluorohexanoic Acid (PFHxA)	ppt	2023	4.7	4.0 - 4.7	Man-made substances found in industrial and consumer products present in drinking water as a result of industrial release and discharges from other sources
Perfluoropentanoic Acid (PFPeA)	ppt	2023	5.9	5.4 - 5.9	
Perfluorohexanesulfonic Acid (PFHxS)	ppt	2023	3.4	2.9 - 3.4	
Perfluorobutanesulfonic Acid (PFBS)	ppt	2023	3.0	ND - 3.0	
Perfluorooctanesulfonic Acid (PFOS)	ppt	2023	3.9	ND - 3.9	

⁵ This is a preliminary data set that is not complete. Sampling and data collection continues into calendar year 2024. The complete data set will provide more conclusive information on the occurrence of PFAS.

Table Definitions

90th Percentile: The levels reported for lead and copper represent the 90th percentile of the total number of sites tested. The 90th percentile is equal to or greater than 90 percent of our lead and copper detections.

AL (Action Level): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements a water system must follow.

MCL (Maximum Contaminant Level): The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

MCLG (Maximum Contaminant Level Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety

MRDL (Maximum Residual Disinfectant Level): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG (Maximum Residual Disinfectant Level Goal): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA: Not applicable.

ND (Not Detected): Indicates that the substance was not found by laboratory analysis.

NTU (Nephelometric Turbidity Units): Measurement of the clarity, or turbidity, of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

ppt (parts per trillion): One part substance per trillion parts water (or nanograms per liter).

ppb (parts per billion): One part substance per billion parts water (or micrograms per liter).

ppm (parts per million): One part substance per million parts water (or milligrams per liter).

Removal Ratio: A ratio between the percentage of a substance actually removed to the percentage of the substance required to be removed.

TT (Treatment Technique): A required process intended to reduce the level of a contaminant in drinking water.



Important Health Information

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline (800-426-4791).

Lead in Home Plumbing

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high-quality drinking water, but we cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using

water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline at (800) 426-4791 or at www.Epa.gov/safewater/lead.

Substances in Water

To ensure that tap water is safe to drink, the U.S. EPA prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of these contaminants does not necessarily indicate that the water poses a health risk.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals, in some cases, radioactive material, and substances resulting from the presence of animals or from human activity. Substances that

may be present in source water include:

- Microbial Contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, or wildlife.
- Inorganic Contaminants, such as salts and metals, which can be naturally occurring or may result from urban storm-water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- Pesticides and Herbicides, which may come from a variety of sources such as agriculture, urban storm-water runoff, and residential uses.
- Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production and may also come from gas stations, urban storm-water runoff, and septic systems.
- Radioactive Contaminants, which can be naturally occurring or may be the result of oil and gas production and mining activities.

For more information about contaminants and potential health effects, call the U.S. EPA's Safe Drinking Water Hotline at (800) 426-4791.